




Scale: 2/1

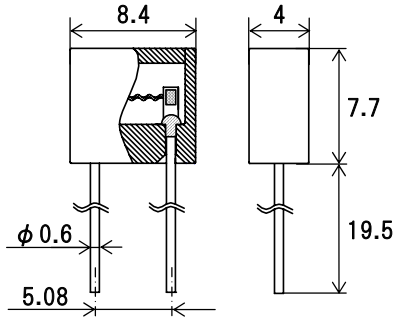

Referential dimensions of mounting holes



Unit: mm

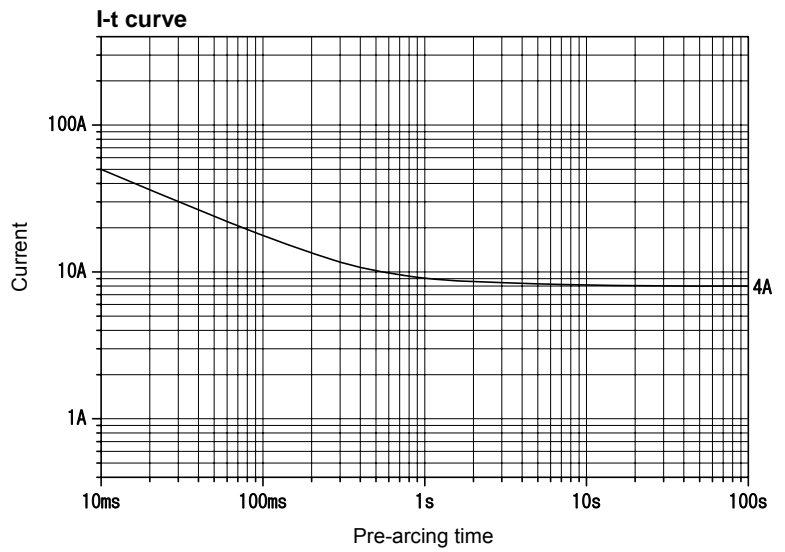

The I-t curve above is a plot of the average values of measurements obtained under conditions specified by SOC. These data are for reference only and are not intended to infer any guaranteed values.

Rated voltage	Certification	Rated current ( $I_N$ )	Rated breaking current		Endurance test	Temp. rise	Pre-arcing time/ current characteristic
AC250V	SEMKO Certified <PS>E JET	4A	40A	PF Over 0.95	*1	*2	*3

\*1: After repeating 100 cycles of  $1.0 I_N$  for 1 h and switching-off for 15 min,  $1.5 I_N$  can be passed through the fuse for 1 h or more.

\*2: 135 K or less on each part of the fuse when  $1.5 I_N$  is applied for 15 min, and then the current is increased by  $0.1 I_N$  every 15 min until the fuse operates.

\*3:

Rated current	$2.1 I_N$	$2.75 I_N$	$4.0 I_N$	$10 I_N$
4A	Within 30min	0.01s - 3s	0.003s - 0.3s	Within 0.02s